


M.T.
3300V

CONTAINER

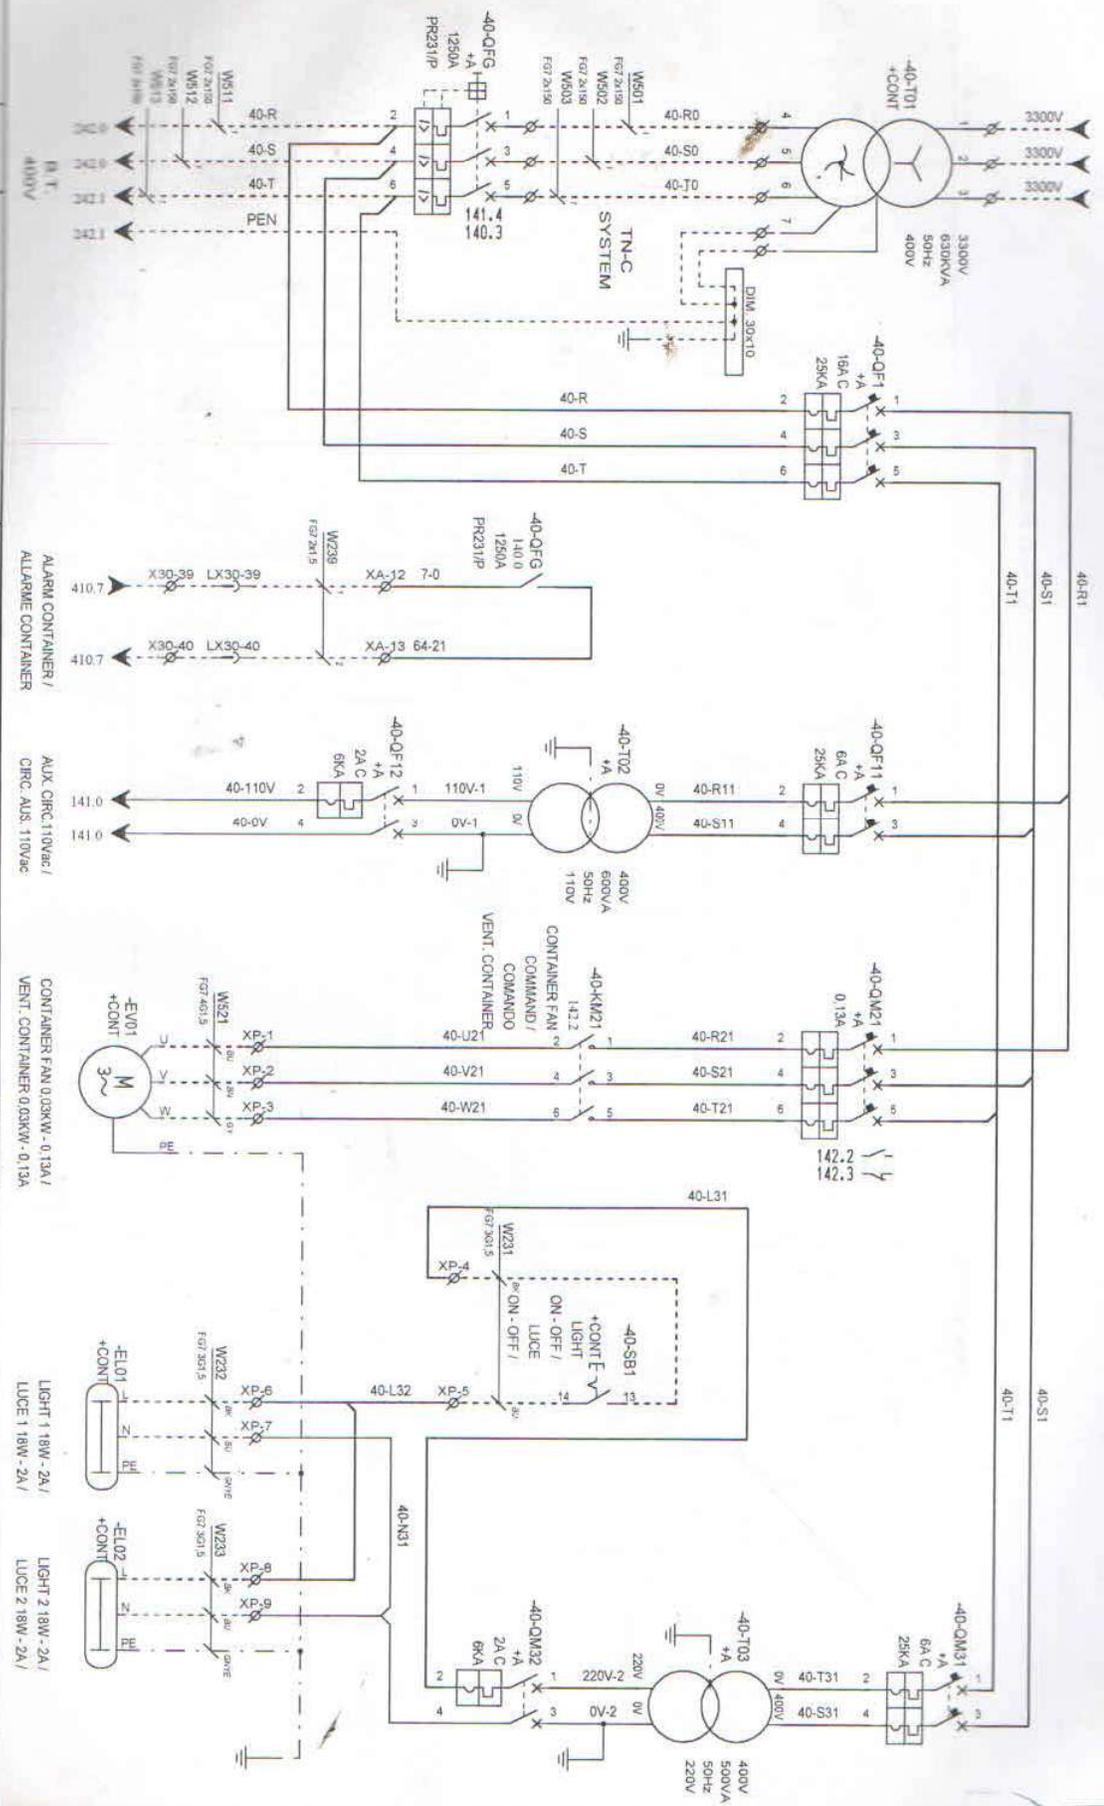

ALARMA CONTAINER /
ALARME CONTAINER

AUX. CIRC. 110VAC /
CIRC. AUS. 110VAC


CONTAINER FAN 0.03KW - 0.13A /
VENT. CONTAINER 0.03KW - 0.13A

LIGHT 1 18W - 2A /
LUCE 1 18W - 2A /
LIGHT 2 18W - 2A /
LUCE 2 18W - 2A /

REV	09/09/2012	MODIFICATION
DATE	09/09/2012	MODIFICATION
Mod. 115-0		
		
PROJECT:	IHC 850	FUNCTION
CLIENT:	Co 1519	
ORDER:	Electric Power System	
TITLE:		
DES.: Simone B.	DATE: 09/09/2012	
SHEET 140		141

CONTAINER

TRANSFORMER TEMPERATURE /
TEMPERATURA TRASFORMATORE

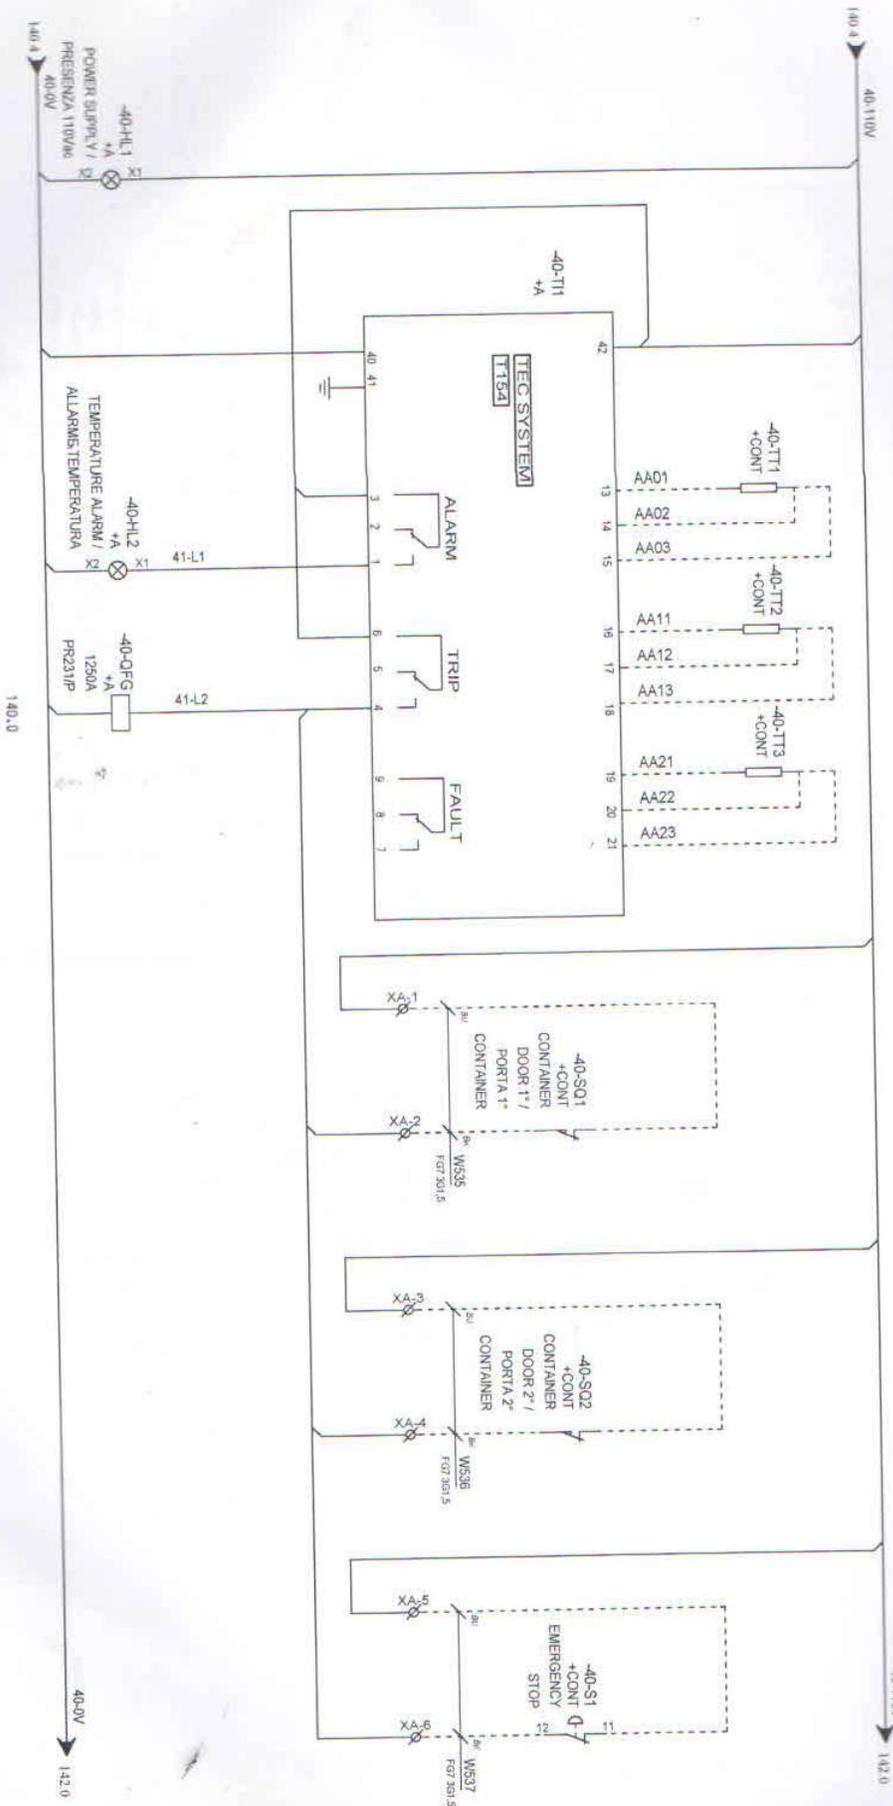

REV	DATE	SIGNAT.	MODIFICATION	Mod. 115-0
2	03/10/2012	Ernestina S		
				
PROJECT: IHC 850				FUNCTION
CLIENT:				
ORDER: C6 1510				
TITLE: Electric Auxiliary System				
DES.: Simone B.				
DATE: 09/08/2012				
				SHEET 141
				SHEET 142

XP

ORIGINE	FILE	MORSETTO	DESTIN
40-KM21	PASTRAL TERMINALE	1	EV01
40-KM21	40-V21	2	EV01
40-KM21	40-W21	3	EV01
40-OM31	40-L31	4	40-SB1
	40-L32	5	40-SB1
	40-L32	6	EL01
40-OM31	40-N31	7	EL01
	40-L32	8	EL02
	40-N31	9	EL02

	BK -W521	
	BU FG7 3G1,5	
	BN	
	BK -W231	
	BU FG7 3G1,5	
	BK -W232	
	BU FG7 3G1,5	
	BK -W233	
	BU FG7 3G1,5	

REV	DATE	SIGNAT.	MODIFICATION
2	03/10/2012	Bannana S	

Mod.115-0



PROJECT: IHC 850	FUNCTION
CLIENT: Co 1519	
ORDER: Terminal XP	
TITLE: XP - 1/1	
DES.: Simone B.	
DATE: 09/09/2012	
	SHEET 145
	146

XA

ORIGINE	PILO	MORSETTO	DESTIN.
40-QF12	40-110V	1	40-S01
40-T11	41-L2	2	40-S01
40-QF12	40-110V	3	40-S02
40-T11	41-L2	4	40-S02
40-QF12	40-110V	5	40-S1
40-T11	41-L2	6	40-S1
40-QF12	40-110V	7	40-T11
40-QM21	42-L1	8	40-T11
40-QFG	7-0	12	X30
40-QFG	64-21	13	X30

BU	-W535
BK	FG7 3G1.5
BU	-W536
BK	FG7 3G1.5
BU	-W537
BK	FG7 3G1.5
BU	-W238
BK	FG7 3G1.5
1	-W239
2	FG7 2x1.5

2	02/10/2012	MODIFICAZIONE
REV	DATE	SIGNAT


Mod.115-0



PROJECT:	IHC 850	FUNCTION
CLIENT:	Co 1519	
ORDER:	Terminal: XA	
TITLE:	XA - 1/1	
DES.: Simone B.	DATE: 09/08/2012	SHEET 146
		150

REV	DATE	SIGNAT.	MODIFICATION
2	09/10/2012	Simone B.	

Mod.115-0

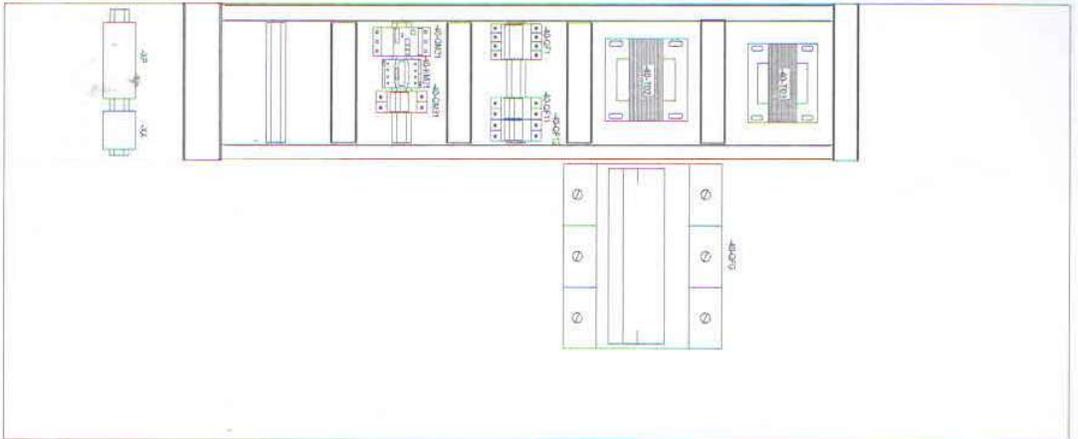

PROJECT:	IHC 890	FUNCTION
CLIENT:	Co 1519	
ORDER:	Board inside view	
TITLE:		
DES.: Simone B.	DATE: 09/08/2012	
		SHEET 150
		151

REV	DATE	MODIFICA
2	01/10/2012	MODIFICA B

MODIFICAZIONE

Mod. 115-0






PROJECT: IHC 850
 CLIENT: Co 1519
 ORDER: Board external view
 TITLE: Board external view
 DES.: Simone B

DATE: 09/09/2012

500

FUNCT

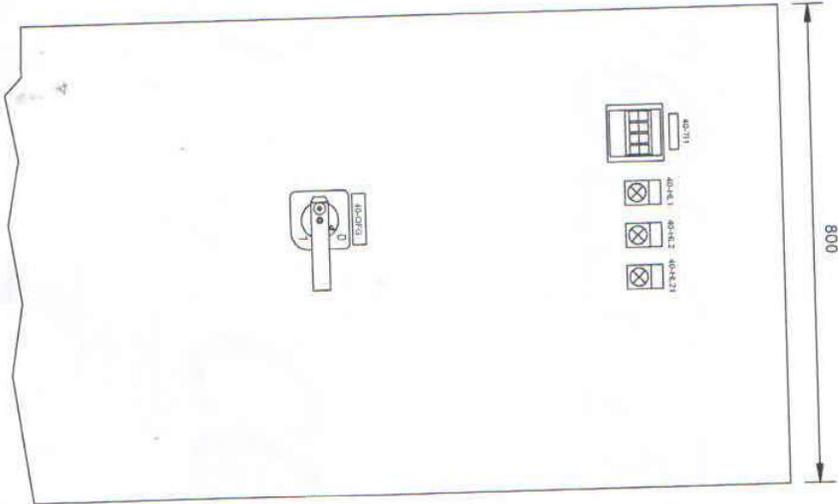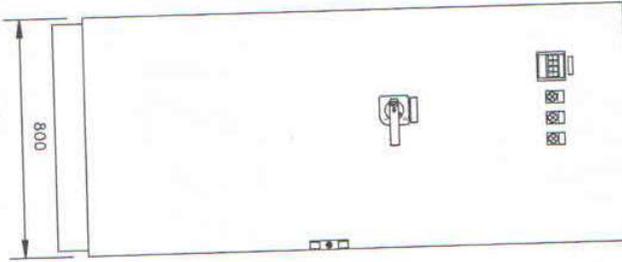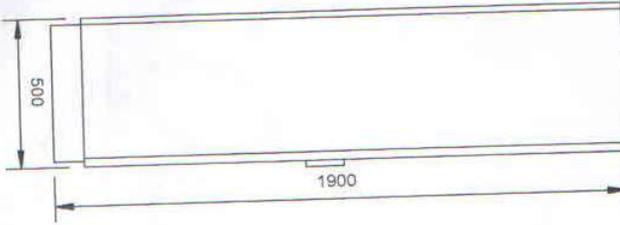

WORDING

- 40-QFG) MAIN SWITCH
- 40-T11) TRANSFORMER TEMPERATURE
- 40-HL1) POWER SUPPLY
- 40-HL2) TEMPERATURE ALARM
- 40-HL21) THERMAL PROTECTION

TARGHETTE

- 40-QFG) INTERRUTTORE GENERALE
- 40-T11) TEMPERATURA TRASFORMATORE
- 40-HL1) PRESENZA 110Vac
- 40-HL2) ALLARME TEMPERATURA
- 40-HL21) INTERVENTO TERMICO